


Part B – Health Facility Briefing & Design

170 Medical Imaging Unit – Nuclear Medicine



*i*HFG

International Health Facility Guidelines

Version 4 May 2014

Table of Contents

170 **Medical Imaging Unit - Nuclear Medicine**..... 3

1 Introduction 3

2 Planning 3

3 Design 6

4 Components of the Unit..... 8

5 Schedule of Accommodation – Medical Imaging Unit – Nuclear Medicine 9

6 Functional Relationship Diagram – Medical Imaging Unit – Nuclear Medicine..... 11

7 References and Further Reading..... 12

170 Medical Imaging Unit - Nuclear Medicine

1 Introduction

Description

The Nuclear Medicine Unit provides facilities for the administration of radiopharmaceutical agents to patients and patient imaging for diagnostic purposes and for treatment. The Nuclear Medicine Unit may be provided within the Medical Imaging Unit or as a freestanding Unit. The Unit may or may not include a Radiopharmacy Laboratory. The size of a unit in terms of numbers and type of cameras will be determined by the service plan and clinical needs.

2 Planning

Model of Care

The model of care will depend on level of services provided as defined in the service plan and the presence or otherwise of PET as a sub-component of the Nuclear Medicine Unit.

In large centres, it will be a discrete unit. If there are only one or two gamma cameras, it may be a discrete sub-Unit of Medical Imaging.

All units will have a Hot Laboratory (Hot Lab). Large centres may or may not include a Radiopharmacy Laboratory that will prepare its own radiopharmaceuticals for general use.

Planning Models

Location

A ground floor site is preferred but if this cannot be achieved, consideration should be given to units above, below and adjoining the proposed location with regards to radiation shielding requirements, the weight of equipment and associated shielding and access for equipment and radioactive isotopes.

The Unit should not act as a thoroughfare to other units of the healthcare facility.

Unit Layout

Staff and patient flows in the Unit are critical to ensure that patients, staff and visitors are not exposed to radiation as a result of travel through or adjacent to areas occupied by dosed patients and scanning rooms. Effective layout can also reduce the need for costly radiation shielding.

Layout should address the need for separation of areas particularly patient and staff corridors and entry areas for outpatients and inpatient on beds/ trolleys.

If provided, the Bone Density Room should be located near the entry to the Nuclear Medicine Unit to ensure patients do not unnecessarily cross areas of radioactivity. The Bone Densitometry room should be located away from dosed patients by distance or shielding to avoid interference to the Bone Density Unit from high ambient radiation levels.

Functional Areas

The Nuclear Medicine Unit consists of the following functional areas:

- Reception/ Administration
- Waiting areas for outpatients and inpatients, including toilets
- Patient holding, observation and recovery area
- Treatment areas including gamma camera rooms, specialised scanning imaging rooms (SPECT, PET, PET/CT, bone densitometry), stress testing facilities
- Support areas including utilities, staff station
- Hot Lab/ Radioactive Waste Store
- Staff areas including offices and amenities

- Teaching and research facilities (Tertiary Centres)

Patient Waiting

Waiting areas should allow separation of dosed and undosed patients, particularly as some patients may need to wait for 45 minutes after dosing for uptake. It is also preferable to separate dosed patients from relatives and visitors to the unit which may include young adults, pregnant women and children. Dosed patients should have access to drinking water and toilet facilities without having to access general waiting areas.

Outpatients should be separated from inpatients for privacy reasons with separate entrances.

Patient Holding, Observation and Recovery Area

An area will be required for patient holding, recovery and observation including the following:

- a dedicated inpatient entry
- curtained bed/ trolley bays for holding, observation and recovery; the configuration of the overall space should permit both dosed and un-dosed patients to be held safely
- a small staff station with hand basin
- support rooms including Dirty Utility, Linen Bay, Sterile Stock Store
- Resuscitation trolley (trolley may be located near the Stress Testing Room).

Gamma Camera

The gamma camera is a device used in Nuclear Medicine to image gamma radiation emitting radioisotopes to view and analyse images of the human body or the distribution of medically injected, inhaled, or ingested radionuclides emitting gamma rays, producing a two dimensional image.

The gamma camera consists of one or more flat crystal planes (detectors) optically coupled to an array of photomultiplier tubes, the assembly is known as a "head", mounted on a gantry. The gantry is connected to a computer system that both controls the operation of the camera as well as acquisition and storage of acquired images. The gamma camera room will require a control area and radiation screening as assessed by Radiation Consultants.

Single Photon Emission Computed Tomography (SPECT)

SPECT is a nuclear medicine tomographic imaging technique using gamma rays, similar to the conventional gamma camera planar imaging system that is able to provide true 3D information. This information is typically presented as cross-sectional slices through the patient, but can be freely reformatted or manipulated as required.

To acquire SPECT images, the gamma camera is rotated around the patient. Projections are acquired at defined points during the rotation, typically every 3-6 degrees. In most cases, a full 360 degree rotation is used to obtain an optimal reconstruction. The time taken to obtain each projection is also variable, but 15-20 seconds is typical. This gives a total scan time of 15-20 minutes.

A SPECT camera may be combined with a computerised tomography (CT) unit to form a hybrid system and fusion imaging of the physiology and anatomy of the area/s being scanned. SPECT/CT requires a separate control room and radiation screening in accordance with CT requirements.

Viewing and Reporting Area

A dedicated room with dimmable lighting will be required for viewing and reporting on scans. Each workstation should accommodate imaging screens, computers for access to imaging and patient information systems, writing and shelving space for reference materials. The number of reporting stations will depend on service level, number of scanning rooms and the staff establishment.

Hot Lab/ Dispensary and Radioactive Waste Store

Radioactive radiopharmaceuticals are stored and prepared ready for administration to the patient in the Hot Lab. A lead screen barrier is required for the dispensary area. The Dispensary should be located adjacent to the patient dosing room.

A radioactive waste storage area may also be incorporated into or adjacent to this space. Provide radiation shielding as advised by Radiation Consultants. The Waste Store will require a sink and basin with hands-free taps for hand washing and equipment decontamination.

Radiopharmacy

The Radiopharmacy is used for preparation, compounding, quality control and dispensing of radiopharmaceuticals for diagnosis and treatment. Radiopharmaceuticals are radioactive isotopes attached to pharmaceutical substances.

Only designated units will have an in-house Radiopharmacy laboratory where cold kits are prepared; these may be used in-house or supplied to other Nuclear Medicine Units.

Many nuclear medicine units (e.g. private practices) may receive a daily delivery of the radiopharmaceutical already prepared and dispensed as individual patient doses. Other isotopes/radionuclides (e.g. gallium, thallium) are delivered weekly or monthly as required, pre-packaged into individual doses for dispensing.

Storage - Equipment & Supplies

Storage is required for:

- collimators and scanning phantoms, within the scanning rooms
- mobile equipment such as wheelchairs, trolleys, lifters and ultrasound scanners, may be located in equipment bays
- Technegas unit and large argon cylinder/s that may be located in an equipment bay; the Technegas unit and trolley is taken to patients in holding bays or in the camera rooms for patient to inhale Tc99m
- medical consumables and smaller equipment items
- sterile stock
- stationery
- records/ files

SPECT and SPECT/ CT Scanning Room -

The SPECT and SPECT/CT Scanning rooms will be used for patient imaging procedures using a SPECT camera or combined SPECT/CT hybrid system. Installation of equipment should be in accordance with manufacturer's recommendations. Room size may vary according to the equipment selected

Scanning rooms require ready access from dosing rooms and dosed patient waiting areas. Scanning rooms may be collocated with shared Control rooms to enable monitoring of two rooms simultaneously.

Some special considerations for SPECT and SPECT/CT Rooms include:

- Floor structure should support the equipment weight.
- Uninterruptible power supply is required to the cameras and associated computer modules to prevent data loss and/or damage during power surges or loss of supply
- Power to patient areas shall be body protected to protect against electric shock
- Individual room temperature and humidity control is required.
- Lighting should be placed to avoid lights shining directly into the patient's eyes and should be dimmable.
- Radiation shielding will be required according to assessment by the Radiation Consultant
- Bed/ trolley access is required to the room
- Fixtures, fittings and equipment within the room will include:
 - Collimator rack/s for a range of collimator sizes should be included; the collimator is a directional guide; the size and length of the collimator holes determine which gamma rays reach the detector in the camera; collimator racks vary according to the model / level of Gamma Camera.
- Patient ECG monitoring may be required in the room
- CCTV camera may be included (optional in SPECT/CT room).
- Lead apron rack and aprons will be required in the room or immediately adjacent.
- hand basin - Type B with paper towel and soap fittings

- Television, ceiling or wall mounted is optional.
- Bench and shelving for preparation and storage may be provided.

Services will include:

- medical gases - oxygen, suction, medical air on service panel
- nurse and emergency call system
- power outlets for patient equipment on the medical services panel and additional power on all walls
- computer data points on patient services panel, near gamma camera unit and in control areas

Store - Radioactive Waste

This room will store radioactive waste materials.

Ready access to the Hot Laboratory is required. Lead lining is required to ensure safe protection of radioactive materials.

Bone Densitometry Room

Bone densitometry is a non-invasive procedure using a special x-ray scanning machine to determine bone density or strength. It is used to identify those at risk of developing osteoporosis and to monitor change in bone density.

The bone densitometry room maybe located within the radiology or nuclear medicine department. The room may have radiation shielding to walls and/or glazing as advised by a Radiation Consultant.

Functional Relationships

The Nuclear Medicine Unit should be located with ready access to the Medical Imaging Unit, PET Unit if provided, Emergency Unit, Operating Unit and Critical Care areas. It requires easy access for ambulant patients and beds/ stretchers.

3 Design

Construction Standards

Construction Standards for a Nuclear Medicine Unit include the following:

- Flooring shall be adequate to meet load requirements for equipment, patients, and personnel.
- Floors and walls should be constructed of materials that are easily decontaminated in case of radioactive spills.
- Walls should contain necessary support systems for either built-in or mobile oxygen and vacuum and; vents for radioactive gases.
- Provision for cable trays, ducts or conduits should be made in floors, walls, and ceilings as required.
- Ceiling height should be a minimum of 3 metres.
- Ceiling mounted equipment should have properly designed rigid support structures located above the finished ceiling.
- A lay-in type ceiling should be considered for ease of installation, service and future remodelling.

Environmental Considerations

Acoustics

Acoustic treatment will be required to the following areas:

- SPECT/CT scanning rooms (hybrid units may be noisy)
- Viewing / reporting room
- Consulting rooms

Refer also to acoustic requirements identified in Standard Components Room Data Sheets.

Natural Light

Natural light is desirable in all patient areas, staff room and staff offices. Lighting level in reporting rooms needs to be adjustable. External windows provided in scanning and uptake rooms should be assessed by a Radiation Consultant for shielding requirements.

Safety and Security

The Nuclear Medicine Unit shall include a safety shower with an eyewash station for use in the event of radioactive spills.

Finishes

Floor finishes and junctions should be smooth, impervious and non-absorbent in case of radiation spills.

Building Service Requirements

Radiation Protection

Plans and specifications will require assessment for radiation protection by a certified physicist or other qualified expert, as required by the appropriate state authorities. The radiation protection assessment will specify the type, location and amount of radiation protection required according to the final equipment selections and layout. Radiation protection requirements shall be incorporated into the final specifications and the building plans.

Radiation shielding will be required to a number of areas as advised by Radiation Consultants including:

- Reception and rooms adjacent to dosed patient rooms
- Dosing/ Consult Exam rooms
- Hot Lab/ Dispensing room/ Radiopharmacy
- Pre-scan uptake rooms/ dosed waiting areas, patient toilets
- Cardiac Stress Testing Room
- Scanning Room/s
- Post scanning waiting areas
- Bone Densitometry Room

Hydraulic Services

Ceiling spaces above gamma cameras and specialty scanning units should not be used for hydraulic services or air-conditioning ducts, to avoid damage to equipment from leakages.

The need for delayed holding tanks within the Nuclear Medicine Unit will require assessment by the Radiation Consultant.

Mechanical Services

Additional cooling and ventilation will be required to Scanning Rooms and associated computer equipment rooms as the equipment is sensitive to excessive ambient heat. Some scanners may require chilled water for cooling. Large temperature changes (greater than 400C per hour) within scanning rooms need to be avoided to reduce the risk of crystal fracture in gamma cameras. Additional air extraction or exhaust may be required to Camera Room/s where ventilation agents such as Technegas are administered.

In the restricted areas of Patient Examination Room and Storage and Preparation areas, if radioactive gas Xenon is being used, special ventilation is required. Ventilation requirements would be in accordance with relevant Guidelines. The restricted area should be kept under negative pressure by exhausting at least 15 % more air than supply air. Recirculation of air from these spaces should not be permitted.

It is recommended that the Storage and Preparation areas be generally equipped with a special radioisotope fume hood. This system may need to be fabricated from non-ferrous materials. Exhaust registers should be located at floor and ceiling levels

General air conditioning inpatient and staff areas needs to be adjustable for patient and staff comfort; the temperature of the Unit should not exceed 25°C.

Smoke detectors in treatment rooms should be sensitive to radiation.

Hot Lab room air should be negatively pressured and exhausted, not recirculated. The Hot Lab may include a fume cabinet which will require exhausting.

Rooms in which Technegas is used should be negatively pressured to the rest of the Unit.

4 Components of the Unit

The Nuclear Medicine Unit will contain to comply with details described in these Guidelines. Refer to Standard Components Room Data Sheets and Room Layout Sheets.

5 Schedule of Accommodation – Medical Imaging Unit – Nuclear Medicine
Entry/Reception Area

ROOM/ SPACE	Standard Component			Level 4 Qty x m2	Level 5 Qty x m2	Level 6 Qty x m2	Remarks
RECEPTION	RECL-10-I RECL-15-I			1 x 10	1 x 10	1 x 15	
WAITING – MALE/FEMALE	WAIT-10-I WAIT-20-I			2 x 10	2 x 15	2 x 20	Separate Male/female areas
MEETING ROOM – SMALL	MEET-9-I MEET-12-I			1 x 9	1 x 9	1 x 12	
OFFICE – SHARED	OFF-2P-I OFF-3P-I			1 x 12	1 x 12	1 x 15	2/3 staff
STORE – PHOTOCOPY/STATIONERY	STPS-8-I STPS-10-I			1 x 8	1 x 8	1 x 10	
STORE - FILES	STFS-8-I STFS-10-I			1 x 8	1 x 8	1 x 10	

Patient & Support Areas

ROOM/ SPACE	Standard Component			Level 4 Qty x m2	Level 5 Qty x m2	Level 6 Qty x m2	Remarks
WAITING – UNDOSED (MALE/FEMALE)	WAIT-SUB-I WAIT-10-I			2 x 5	2 x 5	2 x 5	Separate Male/female areas
PLAY AREA – PAEDIATRIC	PLAP-10-I			1 x 10 optional	1 x 10	1 x 10	
PATIENT BAY – HOLDING (MALE/FEMALE)	PBTR-H-10-I			2 x 10	3 x 10	8 x 10	Separate Male/female areas
BAY - BEVERAGE	BBEV-OP-I			1 x 4	1 x 4	1 x 4	
BAY – HANDWASHING	BHWS-B-I			1 x 1	1 x 1	2 x 1	
BAY – LINEN	BLIN-I			1 x 2	1 x 2	2 x 2	
BAY – RESUSCITATION TROLLEY	BRES-I			1 x 1.5	1 x 1.5	1 x 1.5	
CLEANER'S ROOM	CLRM-5-I			1 x 5	1 x 5	1 x 5	
CONSULT ROOM	CONS-I			1 x 14	2 x 14	4 x 14	Qty dependent on Service Plan
DIRTY UTILITY – SUB	DTUR-S-I DTUR-10-I			1 x 8	1 x 8	1 x 10	
DISPOSAL ROOM	DISP-5-I DISP-8-I			1 x 5	1 x 8	1 x 10	May be shared at Level 4
STAFF STATION/ CLEAN UTILITY	SSCU-I			1 x 9	1 x 9	1 x 9	
STORE – STERILE STOCK	STSS-12-I			1 x 6	1 x 12	1 x 12	
TOILET - ACCESSIBLE PATENT	WCAC-I			2 x 6	2 x 6	4 x 6	
SHOWER – PATIENT MALE/FEMALE	SHPT-I			2 x 4	2 x 4	4 x 4	
CIRCULATION ALLOWANCE %				35%	35%	35%	

Treatment Areas

ROOM/ SPACE	Standard Component			Level 4 Qty x m2	Level 5 Qty x m2	Level 6 Qty x m2	Remarks
GAMMA CAMERA ROOMS (WITH INTERNAL CONTROL)	GCAM-I			1 x 38	1 x 38	1 x 38	
SPECT SCANNING ROOM (WITH CONTROL ROOM)	GCAM-I similar				1 x 42	2 x 42	Size to suit equipment
SPECT/C.T SCANNING ROOM					1 x 48	1 x 48	
SPECT/C.T SCANNING	ANCRT-I				1 x 14	1 x 14	

Medical Imaging Unit – Nuclear Medicine

CONTROL ROOM	similar						
COMPUTER EQUIPMENT ROOM	COEQ-I			1 x 8	3 x 8	4 x 8	
STRESS TESTING	STRT-I			1 x 12	1 x 12	2 x 12	
BONE DENSITOMETRY					1 x 16	1 x 16	
BAY – MOBILE EQUIPMENT	BMEQ-6-I			1 x 6	2 x 6	4 x 6	Qty according to equipment to be accommodated
PROCEDURE ROOM	PROC-20-I					1 x 20	Optional
VIEWING/REPORTING ROOM	XRRR-I			1 x 12	1 x 12	1 x 12	
CIRCULATION ALLOWANCE %				35%	35%	35%	

Hot Laboratory Areas

ROOM/ SPACE	Standard Component			Level 4 Qty x m2	Level 5 Qty x m2	Level 6 Qty x m2	Remarks
ENTRY LOBBY ISOTOPE DELIVERY	AIRL-6-I			1 x 6 optional	1 x 6 optional	1 x 6 optional	Refer to Airlock
HOT LABORATORY (RADIOPHARMACY)	HTLB-I similar			1 x 10	1 x 12	1 x 12	
STORE – RADIOACTIVE WASTE					1 x 20	1 x 20	
BAY – EMERGENCY SHOWER	BES-I			2 x 1	2 x 1	2 x 1	Decontamination; privacy screened
BAY – PPE (PERSONAL PROTECTIVE EQUIPMENT)	BPPE-I			1 x 1.5	1 x 1.5	1 x 1.5	


Staff Support Areas

ROOM/ SPACE	Standard Component			Level 4 Qty x m2	Level 5 Qty x m2	Level 6 Qty x m2	Remarks
OFFICE – SINGLE PERSON 12M2	OFF-S12-I				1 x 12	1 x 12	Director
OFFICE – SINGLE PERSON, 9M2	OFF-S9-I			1 x 9	1 x 9	1 x 9	Nursing Personnel
OFFICE – SINGLE PERSON, 9M2	OFF-S9-I			1 x 9	2 x 9	4 x 9	Medical specialist etc.; Qty depends on service plan
OFFICE – WORKSTATIONS	OFF-WS-I			3 x 5.5	4 x 5.5	6 x 5.5	Qty depends on service plan
MEETING ROOM	MEET-L-15-I MEET-L-20-I			1 x 15	1 x 15	2 x 20	Qty depends on service plan
STAFF ROOM – MALE/FEMALE	SRM-15-I SRM-20-I				2 x 15	2 x 20	Separate Male/female areas
CHANGE - STAFF (MALE/FEMALE)	CHST-10-I CHST-20-I			2 x 10	2 x 14	2 x 20	Separate Male/female areas

Please note the following:

- Areas noted in Schedules of Accommodation take precedence over all other areas noted in the FPU.
- Rooms indicated in the schedule reflect the typical arrangement according to the Role Delineation.
- Exact requirements for room quantities and sizes will reflect Key Planning Units identified in the service plan and the policies of the Unit.
- Room sizes indicated should be viewed as a minimum requirement; variations are acceptable to reflect the needs of individual Unit.
- Office areas are to be provided according to the Unit role delineation and number of endorsed full time positions in the unit.
- Staff and support rooms may be shared between Functional Planning Units dependant on location and accessibility to each unit and may provide scope to reduce duplication of facilities.

6 Functional Relationship Diagram – Medical Imaging Unit – Nuclear Medicine

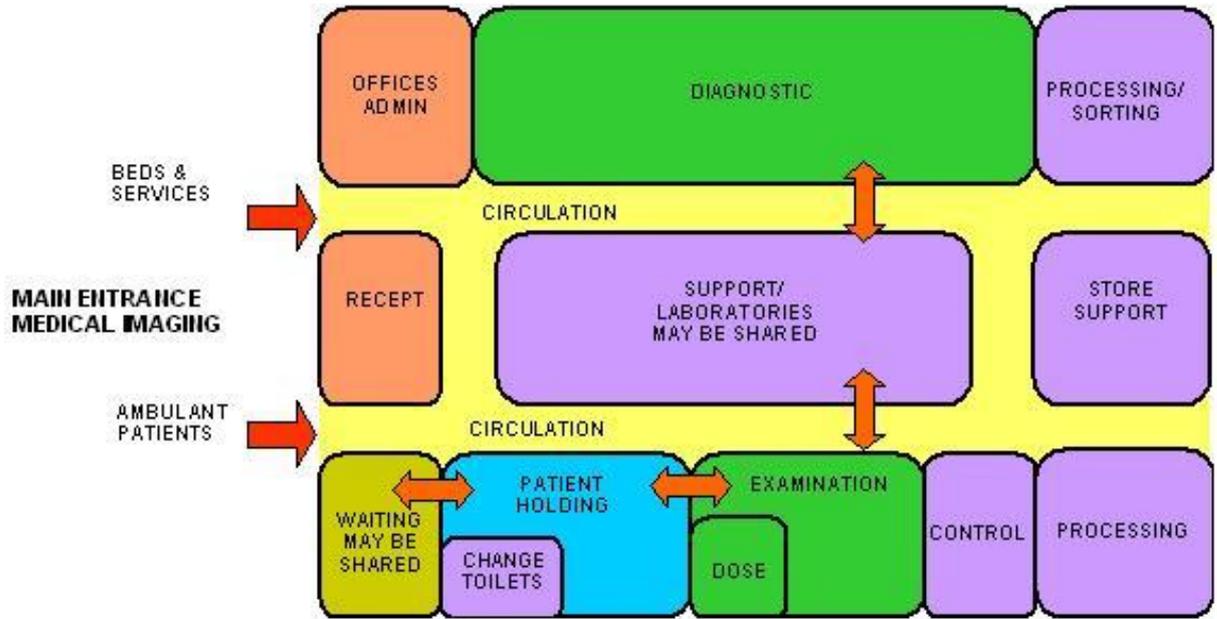

7 References and Further Reading

- Australasian Health Facility Guidelines, Part B Health Facility Briefing and Planning, Rev 5, 2012; refer to website www.healthfacilitydesign.com.au
- Guidelines for Design and Construction of Health Care Facilities; The Facility Guidelines Institute, 2010 Edition; refer to website www.fgiguidelines.org
- NHS Estates, Department of Health Estates and Facilities Division, 14-01, Pharmacy and Radiopharmacy, HMSO, London, 2008, refer to website www.estatesknowledge.dh.gov.uk
- NHS Estates, Department of Health Estates and Facilities Division, HBN 6 Facilities for diagnostic imaging and interventional radiology, HMSO, London, 2001, refer to website www.estatesknowledge.dh.gov.uk



The International Health Facility Guidelines recommends the use of HFBS “Health Facility Briefing System” to edit all room data sheet information for your project.

HFBS provides edit access to all iHFG standard rooms, and departments, and more than 100 custom report templates.

HFBS Health Facility Briefing System



Briefing Module

The Health Facility Briefing System (HFBS) has numerous modules available via annual subscription. It suits healthcare Architects, Medical Planners, Equipment Planners Project Managers and Health Authorities.

Use the HFBS Briefing Module to quickly drag in health facility departments or pre-configured room templates from the iHFG standard, edit the room features such as finishes, furniture, fittings, fixtures, medical equipment, engineering services. The system can print or download as PDF more than 100 custom reports including room data sheets, schedules, and more...

To learn more about the HFBS web-based Healthcare Briefing and Design Software and to obtain editable versions of the “Standard Components” including Room Data Sheets (RDS) and Room Layout Sheets (RLS) offered on the iHFG website, signup for HFBS using the link below.

Get Started Now:
hfbs.healthdesign.com.au

- ✓ iHFG Room Data Sheets and Departments are instantly editable in the HFBS software available online.
- ✓ You can access hundreds of report templates to print your iHFG room data in HFBS.
- ✓ HFBS has a onetime free 3 day trial available to all new users.

Get Started Now:
hfbs.healthdesign.com.au



HFBS

Health Facility Briefing System

hfbsinfo.com | techsupport@healthdesign.com.au